

INSTALLATION INSTRUCTIONS

FOR LPM-01 CONVERSION KIT

GMPV, GMP, GMN, GMPN, GMPH, GPD & PGB

WARNING

This conversion kit must be installed by a qualified service agency in accordance with the manufacturer's instructions and all applicable codes and requirements of the authority having jurisdiction. **If these instructions are not followed exactly, a fire, explosion or production of carbon monoxide may result causing property damage, personal injury or loss of life.** The qualified service agency performing this work assumes responsibility for the proper conversion of this appliance with this kit.

CONVERSION FROM NATURAL GAS TO PROPANE GAS INSTRUCTIONS



The GMP050,075,100,125 & 150 heaters have been CE marked to use propane gas. Before performing this conversion the following tools and supplies are required:

- (2) Pipe Wrenches. These wrenches shall be suitably sized to handle the supply piping and its ground union joint.
- (1) 7/16 (11mm) open or closed wrench. Do not use an adjustable wrench when removing or installing burner orifices.
- (1) 5/16 (8mm) nut driver.
- (1) Flat blade screw driver.
- (1) 3/16 Allen wrench. The Allen wrench is required to remove gas valve inlet and outlet plugs.
- (2) Water Column manometers. Manometers are to be capable of reading a range between 0 and 20 inches (0-50mbar).
Pipe thread compound. Pipe thread compound used must be listed as appropriate material for L.P. gas.
Soap solution and application brush. **NEVER USE AN OPEN FLAME WHEN CHECKING FOR GAS LEAKS.**


1. Prior to performing this conversion refer to Installation & Operation Instructions supplied with the equipment, the National Fuel Gas Code (ANSI Z223.1) or in Canada CAN/CGA-B149.2-M91), local codes and rules in force to ensure that this appliance is installed correctly and in compliance with these codes/manuals.
2. Caution: the gas supply must be shut off prior to disconnecting the electrical power, before proceeding with the conversion.
3. Remove the furnace control access door.
4. Loosen the gas supply ground union, and remove the gas valve supply line. Use one pipe wrench as a back-up to prevent damage/rotation of any controls.
5. Remove the (4) sheet metal screws which fasten the gas manifold to the burner box. See Figure 1 for component location.
6. Using the 7/16 (11mm) wrench remove the existing natural gas orifices from the burner manifold. Discard the natural gas orifices.
7a. GMP, GMN, GMPH, GPD & PGB ONLY: Install the #55 (#12 for CE) LP orifices supplied with this kit into the gas manifold. Tighten these orifices adequately to prevent gas leakage. (For installations in excess of 2,000 feet (610m) above sea level refer to table 1 for the correct LP burner orifices.)
7b. GMPN ONLY: INSTALL THE 1.25mm ORIFICES (B25899-125).

29. Remove the barb fittings and manometers installed on the gas valve. Install the gas valve inlet and outlet pressure plugs, applying pipe joint compound. Check for leaks in the gas supply line using a soap solution.
30. Turn on the gas and electrical supply. Adjust the room thermostat to ensure continuous burner operation.
31. Using a soap solution check the gas supply line, gas valve inlet and outlet pressure areas, threaded portions of the burner orifices, and pressure taps for leaks. **DO NOT USE AN OPEN FLAME.** Repair any gas leaks detected.
32. Observe at least three ignition cycles to ensure smooth and quiet ignition.
33. Install the control access panel.

FIGURE 1

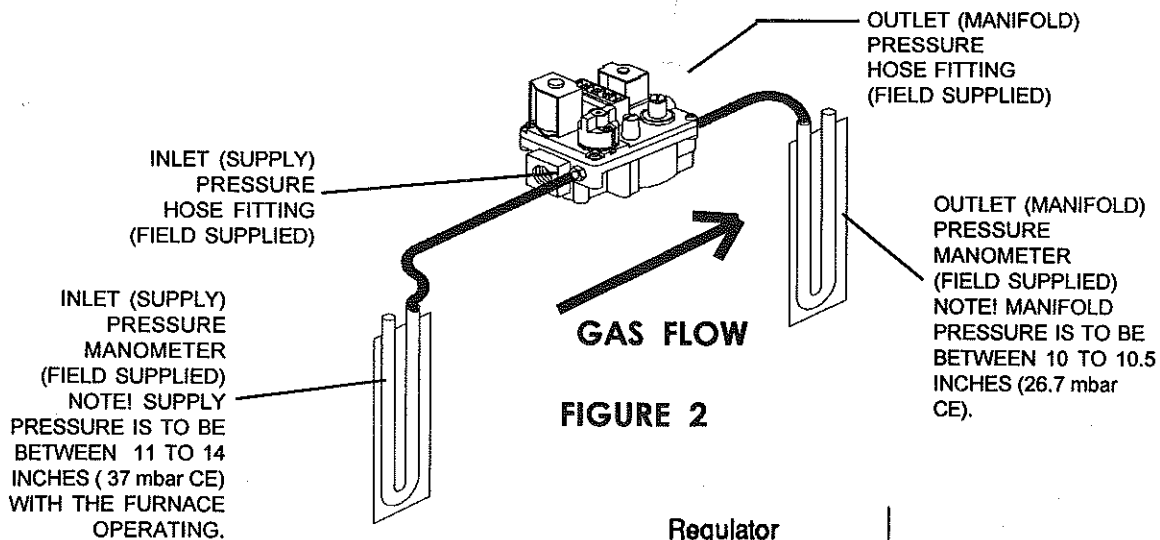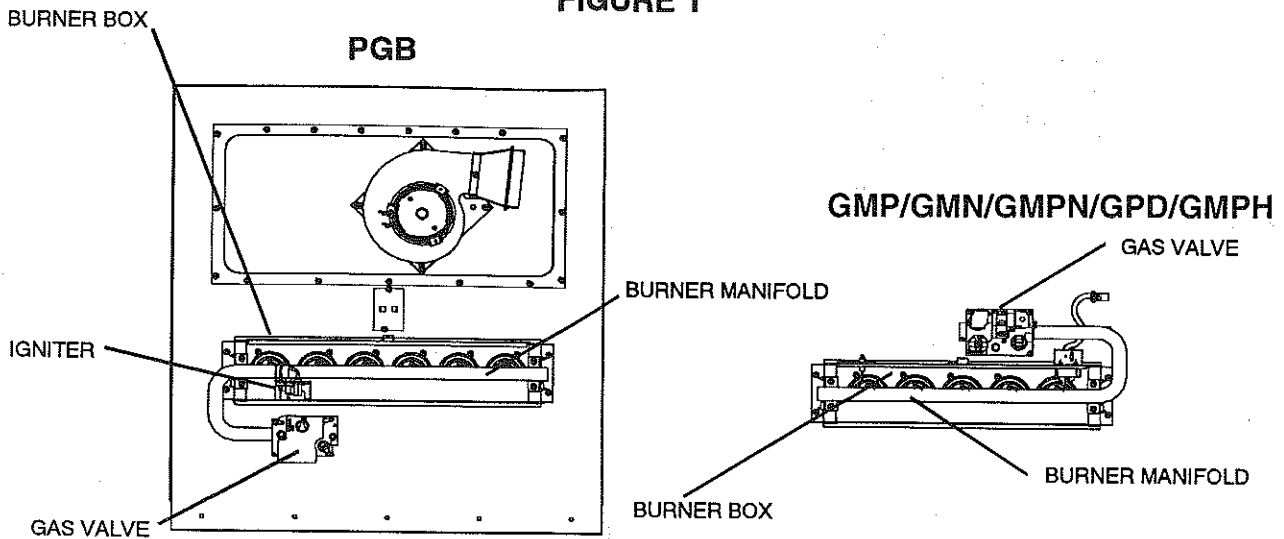

**WHITE ROGERS
GAS VALVE**

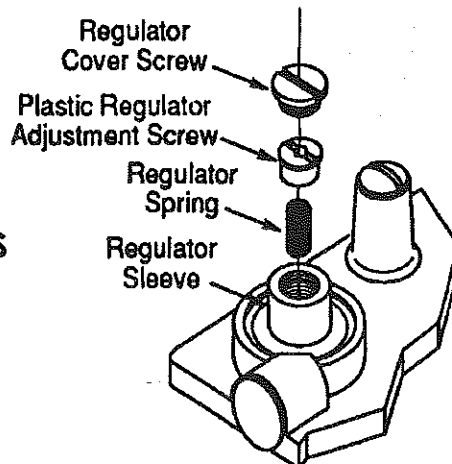

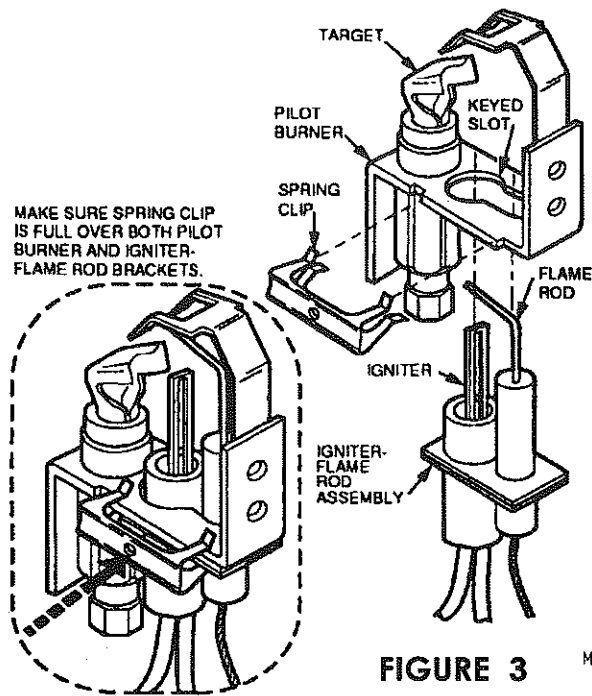


FIGURE 3

HONEYWELL GAS VALVE

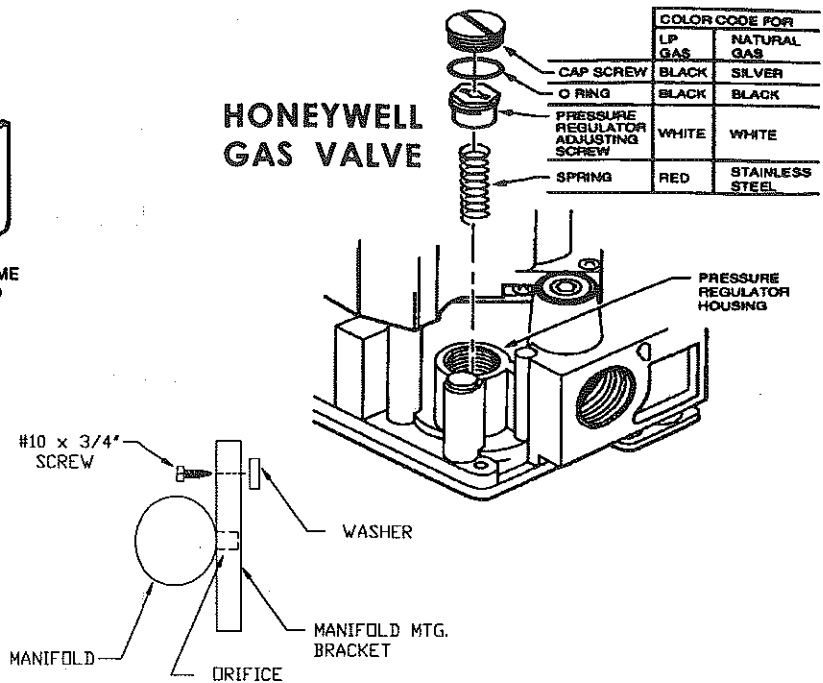


FIGURE 4
GMPN FURNACE ONLY
(SHOWN IN UPFLOW POSITION)

UNIT	NAT	L.P.	L.P. KIT	ORIFICE
GMP050	22,500			43
		20,000	LPM-01	55
GMP	25,000			42
		20,000	LPM-01	55
GMPN	20,000			45
		18,333	LPM-01	1.25mm
GPD	25,000			42
		20,000	LPM-01	55

TABLE REFLECTS INPUT PER CELL (North America Only).

FOR INSTALLATIONS OVER 2,000 FT. (610m) ABOVE SEA LEVEL (U.S. ONLY). REFER TO INSTRUCTIONS CONTAINED IN THE HA-02 KIT OR ANSI Z223.1 (TABLE F-4)

Table 1

ALTITUDE		GMP,GMN,GPD, & PGB	GMPN
		ORIFICE SIZE	ORIFICE SIZE
0 - 2,000	0 - 610m	55*	1.25mm*
2,000 - 3,000	610m - 915m	55*	1.25mm*
4,000	1220m	55*	56
5,000	1525m	56	56
6,000	1830m	56	57
7,000	2135m	56	57
8,000	2440m	56	57

* #55 AND 1.25mm orifices are provided in this kit. (20,000 BTUH/Burner @ 10.5" W.C. (26 mbar) manifold pressure)

Table 1 is based upon the furnace input being reduced 4% per 1000 feet (305m) above sea level. See your distributor for high altitude burner orifices.