

Robertshaw[®]
RS9110

Installation Manual



INSTALLATION MANUAL

This manual covers the following models: **RS9110**

Thermostat Applications Guide

Description	
Gas or Oil Heat	Yes
Electric Furnace	Yes
Heat Pump (No Aux. or Emergency Heat)	Yes
Heat Pump (With Aux. or Emergency Heat)	No
Multi-stage Systems	No
Heat Only Systems	Yes
Heat Only Systems - Floor or Wall Furnace	Yes
Cool Only Systems	Yes
Millivolt	Yes

Table of Contents

Page

Installation Tips	2
Thermostat Quick Reference	3
Subbase Installation	4
Wiring	5-12
Technician Setup Menu	13-17
Attach Faceplate & Install Battery	18
Programming	19-22
Specifications	23

Power Type

Battery Power

Hardwire (Common Wire)

Hardwire (Common Wire) with Battery Backup


A trained, experienced technician must install this product.

Carefully read these instructions. You could damage this product or cause a hazardous condition if you fail to follow these instructions.

INSTALLATION TIPS

Wall locations

The thermostat should be installed approximately 4 to 5 feet above the floor. Select an area with average temperature and good air circulation.

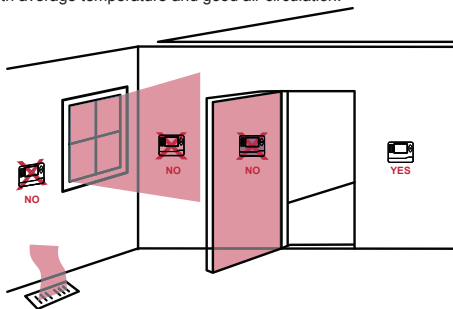

Do not install thermostat in locations:

- Close to hot or cold air ducts
- That are in direct sunlight
- With an outside wall behind the thermostat
- In areas that do not require heating and/or cooling
- Where there are dead spots or drafts (in corners or behind doors)
- Where there might be concealed chimneys or pipes


Tip

2

Pick an installation location that is easy for the user to access. The temperature of the location should be representative of the building.

THERMOSTAT QUICK REFERENCE

Getting to know your thermostat




- ① LCD Screen
- ② Fan Switch
- ③ System Switch
- ④ Temperature Setpoint Buttons
- ⑤ User Buttons
- ⑥ Easy Change Battery Door

① LCD

Days of the week and time.

Displays the user selected setpoint temperature.

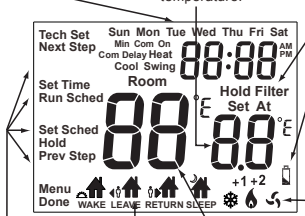

Button Options

Programmable Time Periods:
This thermostat has 4 programmable time periods per day.

Indicates the current room temperature.

Hold: Is displayed when thermostat program is permanently overridden.

Low Battery Indicator: Replace batteries when indicator is shown.

System Operation Indicators: The fan, heat, or cool icon will display when the COOL, HEAT, or fan is on.

NOTE: The compressor delay feature is active if these icons are flashing. The compressor will not turn on until the 5 minute delay has elapsed.

SUBBASE INSTALLATION



Caution: Electrical Hazard

Failure to disconnect the power before beginning to install this product can cause electrical shock or equipment damage.




Mercury Notice:


All of our products are mercury free. However, if the product you are replacing contains mercury, dispose of it properly. Your local waste management authority can give you instructions on recycling and proper disposal.

For vertical mount put
one screw top and one
screw bottom.

For horizontal mount put
one screw left and one
screw right.

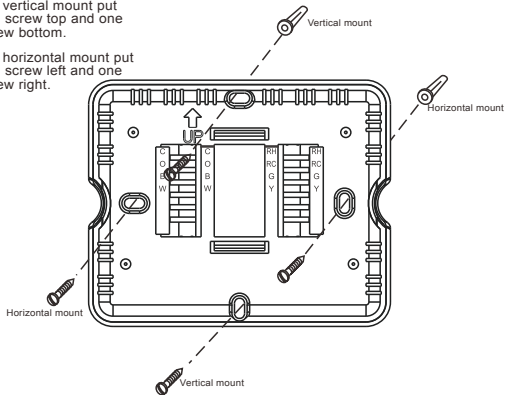

1 Turn Off Power to Heating/Cooling System

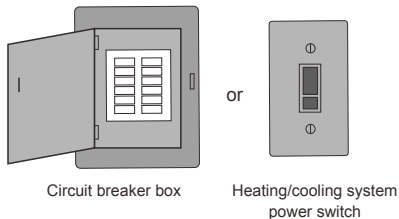


2 Remove Old Thermostat

Remove old thermostat but leave wallplate with wires attached.

Do not remove wallplate

Terminal designation

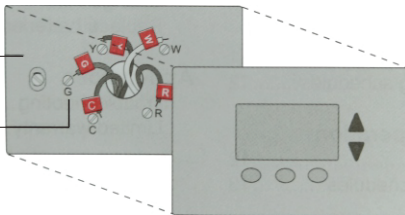

WIRING

3 Label Wires with Tags


Label the wires using the supplied wire labels as you disconnect them.

Wiring Labels

Apply these wiring labels to each wire with the appropriate terminal designation as you remove it from the existing thermostat.

B	B	Y2	Y2	C	C	E	E	F	F
G	G	H	H	L	L	O	O	P	P
R	R	RC	RC	RH	RH	T	T	U	U
V/VR	V/VR	W	W	W1	W1	W2	W2	W3	W3
X	X	X1	X1	X2	X2	Y	Y	Y1	Y1
AUX	AUX								


Wire Labels

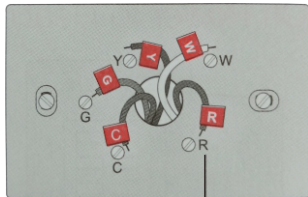

Terminal designation

4 Separate Wallplate from New Thermostat


Remove wallplate from the new thermostat and mount onto wall.



Wallplate

5 Mount Wallplate for New Thermostat

Mount the new wallplate using the included screws and anchors.

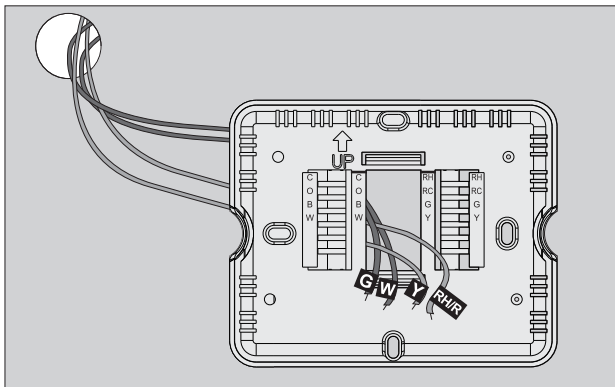


Drill 3/16-in. holes for drywall
 Drill 3/16-in. holes for plaster

WIRING

6 Connect Wires


Simply match wire labels.

If labels do not match letters on the thermostat, check "Alternate Wiring (Conventional Systems)" on page 9 and connect to terminal as shown (see notes, below).

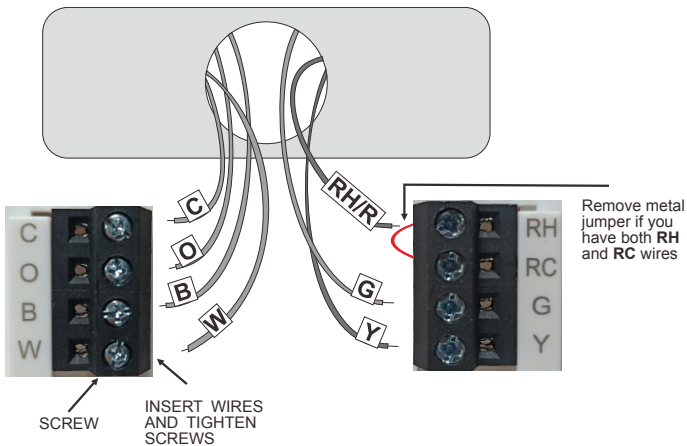

Alternate Wiring (Conventional Systems)

If labels do not match letters on the thermostat, check the chart below and connect to terminal as shown here (See notes, below).

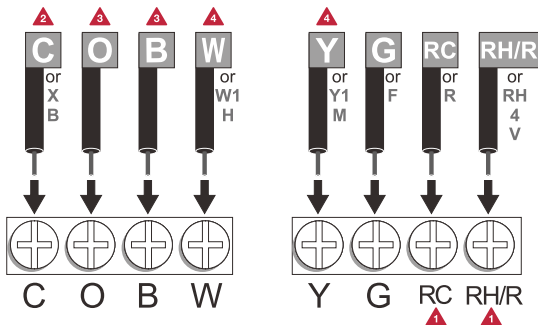

- 1** If wires will be connected to both **RC** and **RH/R** terminals, remove metal jumper.
- 2** If **C** or **X** wire is available then you can connect with **C** terminal. If there is no **C** or **X** wire then no need to connect with C terminal.
- 3** If you have a **heat pump** without auxiliary/backup heat connect **O** or **B**, not both. If you do not have a **heat pump**, do not connect **B**. Wrap bare end of wire with electrical tape.
- 4** Place a jumper (piece of wire) between **Y** and **W** if you are using a heat pump without auxiliary/backup heat.

WIRING



Caution: Electrical Hazard

Failure to disconnect the power before beginning to install this product can cause electrical shock or equipment damage.



Warning:

All components of the control system and the thermostat installation must conform to Class II circuits per the NEC Code.

Wiring

1. If you are replacing a thermostat, make note of the terminal connections on the thermostat that is being replaced. In some cases the wiring connections will not be color coded. For example, the green wire may not be connected to the **G** terminal.
2. Loosen the terminal block screws. Insert wires then retighten terminal block screws.

Terminal Designations

- W** Heat relay **G** Fan relay **Y** Compressor relay
O Heat pump reversing valve energized in cooling
RC Transformer power for cooling
RH Transformer power for heating
B Heat pump reversing valve energized in heating
C Common wire from system transformer

Tips:

RH & RC terminals

For single transformer systems, leave the jumper wire in place between RH and RC. Remove jumper wire for two transformer systems.

Heat pump systems (With No AUX or Emergency Heat)

If wiring to a heat pump, use a small piece of wire (not supplied) to connect terminals W and Y.

C terminal

The C (common wire) terminal does not have to be connected when the thermostat is powered by batteries.


Wire specifications

Use shielded or non-shielded 18-22 gauge thermostat wire.


WIRING

- 1 Power supply.
- 2 Factory-installed jumper. Remove only when installing on 2-transformer systems.
- 3 Use either O or B terminals for reversing valve.
- 4 Use a small piece of wire (not supplied) to connect W and Y terminals.
- 5 Set fan operation switch to electric.
- 6 Optional 24 VAC common connection when thermostat is used in battery power mode.

Typical 1H/1C system: 1 transformer

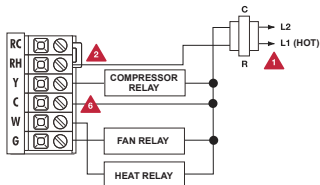


Typical 1H/1C system: 2 transformers

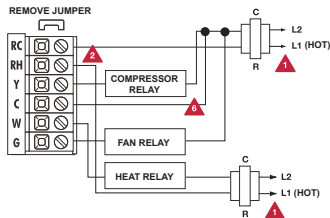


WIRING


Typical 1H/1C heat pump system

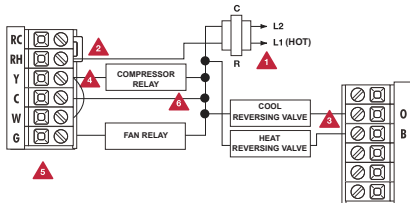


Typical heat-only system

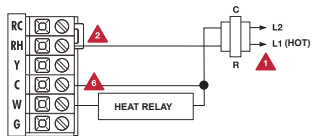

Typical heat-only system with fan

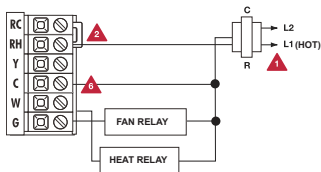

Typical cool-only system

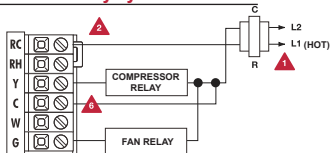



TECHNICIAN SETUP MENU

Technician Setup Menu

This thermostat has a technician setup menu for easy installer configuration. To setup the thermostat for your particular application:




1. Press **MENU** button
2. Press and hold **TECH SET** button for 3 seconds. This 3 second delay is designed so that homeowners do not accidentally access the installer settings.
3. Configure the installer options as desired using the table below.

Use the  or  keys to change settings and the **NEXT STEP** or **PREV STEP** key to move from one option to another. **Note:** Only press **DONE** key when you want to exit the Technician Setup options.




Tip

Temperature differential or swing, sometimes called cycle rate, can be customized for this individual application. For most applications choose a differential setting that is as long as possible without making the occupants uncomfortable.

TECHNICIAN SETUP MENU

Tech Settings	LCD Will Show Adjustment Options	Default	
Filter Change Reminder	<p>Next step OFF</p>  <p>Prev step</p>	<p>You can adjust the filter change reminder from OFF to 2000 hours of run time in 50 hour increments. Tap the second button from the top left side of the thermostat to display the current filter elapsed run time.</p>	OFF
Room Temperature Calibration	<p>Next step CAL</p>  <p>Prev step</p>	<p>You can adjust the room temperature display to read 3° above or below the factory calibrated reading.</p>	0
Minimum Compressor On Time	<p>Next step OFF</p>  <p>Prev step</p>	<p>You can select the minimum compressor run time from OFF, 3, 4, or 5 minutes. If 3, 4 or 5 is selected, the compressor will run for at least the selected time before turning off.</p>	OFF


TECHNICIAN SETUP MENU

Tech Settings	LCD Will Show Adjustment Options	Default	
Compressor Short Cycle Delay	<p>Next step ON</p>  <p>Prev step</p>	Selecting ON will not allow the compressor to be turned on for 5 minutes after the last time the compressor was on. Select OFF to remove this delay.	ON
Cooling Differential or Swing	<p>Next step dF CO</p>  <p>Prev step</p>	The cooling differential setting is adjustable from 0.2° to 2°. For example: A differential setting of 0.5° will turn the cooling on at approximately 0.5° above the setpoint and turn the cooling off at approximately 0.5° below the setpoint.	0.5
Heating Differential or Swing	<p>Next Step dF HE</p>  <p>Prev step</p>	The heating differential setting is adjustable from + 0.2° to + 2°. For example: A differential setting of 0.5° will turn the heating on at approximately 0.5° below the setpoint and turn the heating off at approximately 0.5° above the setpoint.	0.4

TECHNICIAN SETUP MENU

Tech Settings	LCD Will Show Adjustment Options	Default
<p>F or C</p> <p>Select F for Fahrenheit temperature readout or select C for Celsius readout.</p>	<p>Next step</p> <p>82 °F</p> <p>Prev step</p> <p>F for Fahrenheit C for Celsius</p>	<p>F</p>
<p>12 or 24 Hour Clock</p> <p>You can select either a 12 or 24 hour clock setting.</p>	<p>Next step</p> <p>24H</p> <p>Prev step</p> <p>Use the <input type="checkbox"/>+ and <input type="checkbox"/>- to select 12 or 24 hour clock.</p>	<p>12</p>
<p>Fan Operation</p> <p>Select GAS for systems that control the fan during a call for heat. Select ELEC to have the thermostat control the fan during a call for heat.</p>	<p>Next step</p> <p>GAS</p> <p>Prev step</p> <p>GAS - GS or ELEC - EL</p>	<p>GAS</p>


TECHNICIAN SETUP MENU

Tech Settings	LCD Will Show Adjustment Options	Default
<p>Program Options</p> <p>You can configure this thermostat to have 7 Day, 5+1+1 programming or non-programmable.</p> <p>Note: If 7d is selected, in set schedule you will program all seven days individually.</p> <p>If 5d is selected, in set schedule you will program Monday - Friday together and Saturday and Sunday individually.</p> <p>If 0d is selected the thermostat becomes non-programmable and the Set Schedule button goes away in Menu.</p>	 <p>Use the [+] and [-] key to select 7d for 7 Day, 5d for 5+1+1, or 0d for non-programmable.</p>	<p>5d</p>

ATTACH FACEPLATE & INSTALL BATTERY


Attach Faceplate

Align the 4 tabs on the subbase with corresponding slots on the back of the thermostat, then push gently until the thermostat snaps in place.

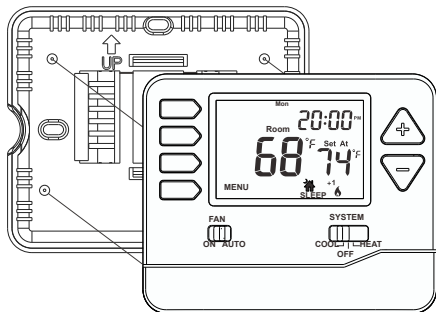

Battery Installation

Battery installation is optional if thermostat is hardwired (C terminal connected).

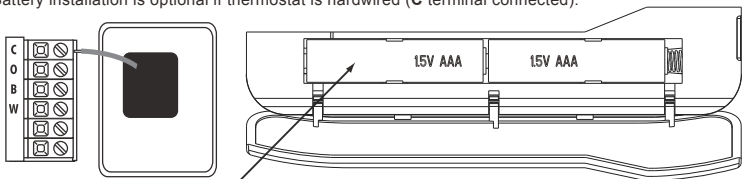







18

Insert 2 AAA Alkaline batteries.

Set Time

Follow the steps below to set the day of the week and current time:













1. Press **MENU**.
2. Press **SET TIME**.
3. Day of the week will be flashing. Use the  or  key to select the current day of the week.
4. Press **NEXT STEP**.
5. The current hour is flashing. Use the  or  key to select the current hour. When using 12-hour time, make sure the correct a.m. or p.m. choice is selected.
6. Press **NEXT STEP**.
7. Minutes are now flashing. Use the  or  or key to select current minutes.
8. Press **DONE** when completed.

Programming

All programmable thermostats are shipped with an energy saving pre-program. You can customize this default program by following the steps below.

























Your thermostat can be programmed to have all the weekdays the same, a separate program for Saturday, and a separate program for Sunday. There are four time periods for each program (**WAKE, LEAVE, RETURN, SLEEP**).

PROGRAMMING

Factory Default Program				
Day of the Week	Events	Time	Setpoint Temperature (Heat)	Setpoint Temperature (Cool)
Weekday	Wake 	6 a.m.	70° F (21° C)	75° F (24° C)
	Leave 	8 a.m.	62° F (17° C)	83° F (28° C)
	Return 	6 p.m.	70° F (21° C)	75° F (24° C)
	Sleep 	10 p.m.	62° F (17° C)	78° F (26° C)
Saturday	Wake 	8 a.m.	70° F (21° C)	75° F (24° C)
	Leave 	10 a.m.	62° F (17° C)	83° F (28° C)
	Return 	6 p.m.	70° F (21° C)	75° F (24° C)
	Sleep 	11 p.m.	62° F (17° C)	78° F (26° C)
Sunday	Wake 	8 a.m.	70° F (21° C)	75° F (24° C)
	Leave 	10 a.m.	62° F (17° C)	83° F (28° C)
	Return 	6 p.m.	70° F (21° C)	75° F (24° C)
	Sleep 	11 p.m.	62° F (17° C)	78° F (26° C)

PROGRAMMING

You can use the table below to plan your customized program schedule.





Programming Table				
Day of the Week	Events	Time	Setpoint Temperature (Heat)	Setpoint Temperature (Cool)
Weekday	Wake  			
	Leave  			
	Return  			
	Sleep  			
Saturday	Wake  			
	Leave  			
	Return  			
	Sleep  			
Sunday	Wake  			
	Leave  			
	Return  			
	Sleep  			

PROGRAMMING

Set Program Schedule

To customize your program schedule, follow these steps

Weekday:

1. Select **HEAT** or **COOL** from the system switch.
Note: You have to program heat and cool separately.
2. Press **MENU**.
3. Press **SET SCHED**. Note: Monday-Friday is displayed and the **WAKE** icon is shown. You are now programming the wake time period for the weekday setting.
4. Time is flashing. Use the  or  key to make your time selection for the weekday **WAKE** time period.
5. Press **NEXT STEP**.
6. The setpoint temperature is flashing. Use the  or  key to make your setpoint selection for the weekday wake period.
7. Press **NEXT STEP**.
8. Repeat steps 4 through 7 for weekday **LEAVE** time period, for weekday **RETURN** time period, and for weekday **SLEEP** time period.

Saturday:

9. Repeat steps 4 through 7 for Saturday **WAKE** time period, for Saturday **LEAVE** time period, for Saturday **RETURN** time period, and for Saturday **SLEEP** time period.

Sunday:

10. Repeat steps 4 through 7 for Sunday **WAKE** time period, for Sunday **LEAVE** time period, for Sunday **RETURN** time period, and for Sunday **SLEEP** time period.

Specifications


The display range of temperature.....	41°F to 95°F (5°C to 35°C)
The control range of temperature	44°F to 90°F (7°C to 32°C)
Load rating	1 amp per terminal, 1.5 amp maximum all terminals combined
Display accuracy	± 1°F
Differential (cycle rate or swing).....	Heating is adjustable from 0.2°F to 2.0°F Cooling is adjustable from 0.2°F to 2.0°F
Power source	18 to 30 VAC, NEC Class II, 50/60 Hz for hardwire (common wire) Battery power from 2 AAA Alkaline batteries
Operating ambient temperature.....	32°F to +105°F (0°C to +41°C)
Operating humidity	90% non-condensing maximum
Dimensions of thermostat	4.72"W x 3.86"H x 0.98"D







Customer Service +1.800.304.6563
Technical Service +1.800.445.8299
HVACCustomerService@robertshaw.com
www.robertshaw.com • 352-00303-001



6 Year
Limited
Warranty

Use Phone
to Scan for
Warranty Info